


Medium Voltage (36kv)




**OBLUM**  
50 YEARS OF EXCELLENCE

# Pioneering Cutting-Edge Solutions for Tomorrow



Powering Progress for Over  
Half a Century: We've been  
at the forefront of electrical  
polymer surge arresters  
manufacturing, continuously  
innovating for 50+ years,  
delivering solutions that  
energize the world.

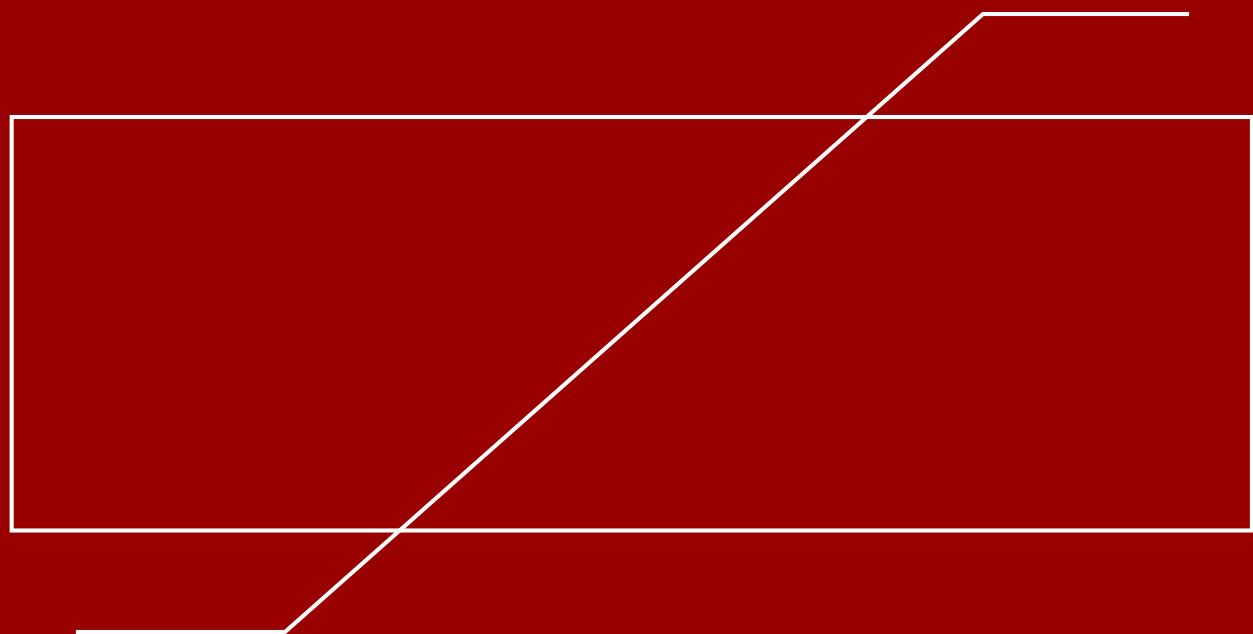



# Global Presence

Oblum business operations are present in multiple geographies across the globe. We are committed to our vision of driving positive change in the environment and in the lives of people.

## Asian Countries

- Philippines
- Iraq
- Bangladesh
- Srilanka
- Turkey
- Abu Dhabi
- Bhutan
- Malaysia
- Nepal
- Uganda
- Uae
- Afghanistan
- Vietnam
- Sharjah
- Nigeria
- Colombo
- Kabul
- Jordan
- Kenya
- Yemen
- Dubai
- Armenia
- Georgia
- Japan
- Kuwait



## African Countries

- Kenya
- Rwanda
- Togo
- Mali
- Zambia
- Burkina Faso
- Mozambique
- Congo
- Tanzania
- Uganda
- South Africa
- Ivory Coast
- Ethiopia
- Botswana
- Liberia
- Transco Clsg
- Ghana
- Sierra Leone
- Gambia

## South American Countries

- Peru
- Paraguay

## North American Countries

- Nicaragua
- Canada

## European Countries

- Finland
- Spain

# Medium Voltage (36kv)

INDOOR SPF			
S No	Description	36kV 10kA SL	36kV 10kA SM
	Model	SPF	SPF
	OUTDOOR/ INDOOR	INDOOR	INDOOR
	System earthing	solidly / ineffectively earthed system	solidly / ineffectively earthed system
1	Highest system voltage kV rms	36	36
2	Nominal system voltage kVrms	33	33
3	Ur -Rated voltage kVrms	36	36
4	Uc -MCOV(kVrms)	30.6	30.6
5	In -NDC (8/20μs) kA	10	10
6	Arrester classification	Station Low duty	Station Medium Duty
7	Qrs (IEC 99-4 Ed.3) in coulomb	1	1.6
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7
9	Qth (IEC 99-4 Ed.3) in coulomb		
10	Max RDV kVp		
	a) 5kA	102	96
	b) 10kA	108	102
	c) 20kA	120	114
11	Max. Switch. Imp. RDV(kVp)		
	a) 500A	86	
	b) 1000A		81
	c) 2000A		
12	Max. Steep Current impulse RDV(kVp) at NDC	120	114
13	High current impulse withstand value (4/10 μs) kA	100	100
14	TOV (kVp)		
	i. 0.1	63	63
	ii. 1.0Sec	61	61
	iii. 10.0Sec	59	59
	iv. 100.0Sec	56	56
15	Short circuit current kA	25/31.5 (as applicable)	25/31.5 (as applicable)
16	Insulation Withstand		
	a) Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	b) Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	c) Switching Imp (Wet)(kVp)	NA	NA
17	Rated frequency (Hz)	48 to 62	48 to 62
18	Leakage current		
	a. IR at MCOV in μA	Less than 400	Less than 400
	b. IC at MCOV in mA	About 1.2	About 1.4
19	Reference voltage in Volt at Reference current in mA	> 36kV at 2mA	> 36kV at 3mA
20	Partial discharge P.D	10pC	10pC
21	Creepage distance-mm (min) Phase to Phase	NA	NA
22	Max. Cantilever strength of arrester Kgf	NA	NA

## MEDIUM STATION PBW

S No	Description	36kV 10kA SL	36kV 10kA SM	
		PBW	PBW	
<b>OUTDOOR/ INDOOR</b>				
<b>System earthing</b>				
1	Highest system voltage kV rms	36	36	
2	Nominal system voltage kVrms	33	33	
3	Ur –Rated voltage kVrms	36	36	
4	Uc -MCOV(kVrms)	30.6	30.6	
5	In –NDC (8/20 $\mu$ s) kA	10	10	
6	Arrester classification	Station Low duty	Station Medium Duty	
7	Qrs (IEC 99-4 Ed.3) in coulomb	1	1.6	
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7	
9	Qth (IEC 99-4 Ed.3) in coulomb			
10	Max RDV kVp			
	a) 5kA	102	96	
	b) 10kA	108	102	
	c) 20kA	120	114	
11	Max. Switch. Imp. RDV(kVp)			
	a) 500A	86		
	b) 1000A		81	
	c) 2000A			
12	Max. Steep Current impulse RDV(kVp) at NDC	120	114	
13	High current impulse withstand value (4/10 $\mu$ s) kA	100	100	
14	TOV (kVp)			
	i. 0.1	63	63	
	ii.1.0Sec	61	61	
	iii. 10.0Sec	59	59	
	iv. 100.0Sec	56	56	
15	Short circuit current kA	25/31.5 (as applicable )	25/31.5 (as applicable )	
16	Insulation Withstand			
	a) Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014	
	b) Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014	
	c) Switching Imp (Wet)(kVp)	NA	NA	
17	Rated frequency (Hz)	48 to 62	48 to 62	
18	Leakage current			
	a. IR at MCOV in $\mu$ A	Less than 400	Less than 400	
	b. IC at MCOV in mA	About 1.2	About 1.4	
19	Reference voltage in Volt at Reference current in mA	> 36kV at 2mA	> 36kV at 3mA	
20	Partial discharge P.D	10pC	10pC	
21	Creepage distance-mm (min) Phase to Phase	25mm/kV /31mm/kV (as applicable)	25mm/kV /31mm/kV (as applicable)	
22	Max. Cantilever strength of arrester Kgf	150	150	

MEDIUM STATION PBC			
<b>S No</b>	<b>Description</b>	<b>36kV 10kA SL</b>	<b>36kV 10kA SM</b>
	<b>Model</b>	<b>PBC</b>	<b>PBC</b>
<b>OUTDOOR/ INDOOR</b>			
<b>System earthing</b>			
1	Highest system voltage kV rms	36	36
2	Nominal system voltage kVrms	33	33
3	Ur –Rated voltage kVrms	36	36
4	Uc -MCOV(kVrms)	30.6	30.6
5	In –NDC (8/20μs) kA	10	10
6	Arrester classification	Station Low duty	Station Medium Duty
7	Qrs (IEC 99-4 Ed.3) in coulomb	1	1.6
8	Wth (IEC 99-4 Ed.3) in kJ/kV	4	7
9	Qth (IEC 99-4 Ed.3) in coulomb		
10	Max RDV kVp		
	a) 5kA	102	96
	b) 10kA	108	102
	c) 20kA	120	114
11	Max. Switch. Imp. RDV(kVp)		
	a) 500A	86	
	b) 1000A		81
	c) 2000A		
12	Max. Steep Current impulse RDV(kVp) at NDC	120	114
13	High current impulse withstand value (4/10 μs) kA	100	100
14	TOV (kVp)		
	i. 0.1	63	63
	ii. 1.0Sec	61	61
	iii. 10.0Sec	59	59
	iv. 100.0Sec	56	56
15	Short circuit current kA	40	40
16	Insulation Withstand		
	a) Lightning Impulse (kVp)	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	b) Power frequency kVrms	As per IEC 60099-4 2014	As per IEC 60099-4 2014
	c) Switching Imp (Wet)(kVp)	NA	NA
17	Rated frequency (Hz)	48 to 62	48 to 62
18	Leakage current		
	a. IR at MCOV in μA	Less than 400	Less than 400
	b. IC at MCOV in mA	About 1.2	About 1.4
19	Reference voltage in Volt at Reference current in mA	> 36kV at 2mA	> 36kV at 3mA
20	Partial discharge P.D	10pC	10pC
21	Creepage distance-mm (min) Phase to Phase	25mm/kV /31mm/kV (as applicable)	25mm/kV /31mm/kV (as applicable)
22	Max. Cantilever strength of arrester Kgf	150	150

**Exports/Technical :**

**Ms.Bhargavi**

Ph: +91 89770 89857

E : [bhargavi@oblum.co.in](mailto:bhargavi@oblum.co.in)

[overseas@oblum.co.in](mailto:overseas@oblum.co.in)

**Technical :**

**Mrs. Nagalakshmi**

Ph :+91 9848352440

E : [nagalakshmi.k@oblum.co.in](mailto:nagalakshmi.k@oblum.co.in)

[technical@oblum.co.in](mailto:technical@oblum.co.in)

**Oblum Electrical Industries (P) Ltd.**

#A-16&17, Assisted Private Industrial  
Estate, Balanagar, Hyderabad - 500 037

Land Line: 040-2377 1880

GST : 36AAACO2289A1ZQ

[www.oblum.co.in](http://www.oblum.co.in)

